

Transfer Station Offices



Middletown Avenue Landfill
New Haven, Connecticut

Power Plan

Drawn by: SKB Checked by: CKS
Date: JULY 2, 1990
Revisions:

E102

1115-09-B

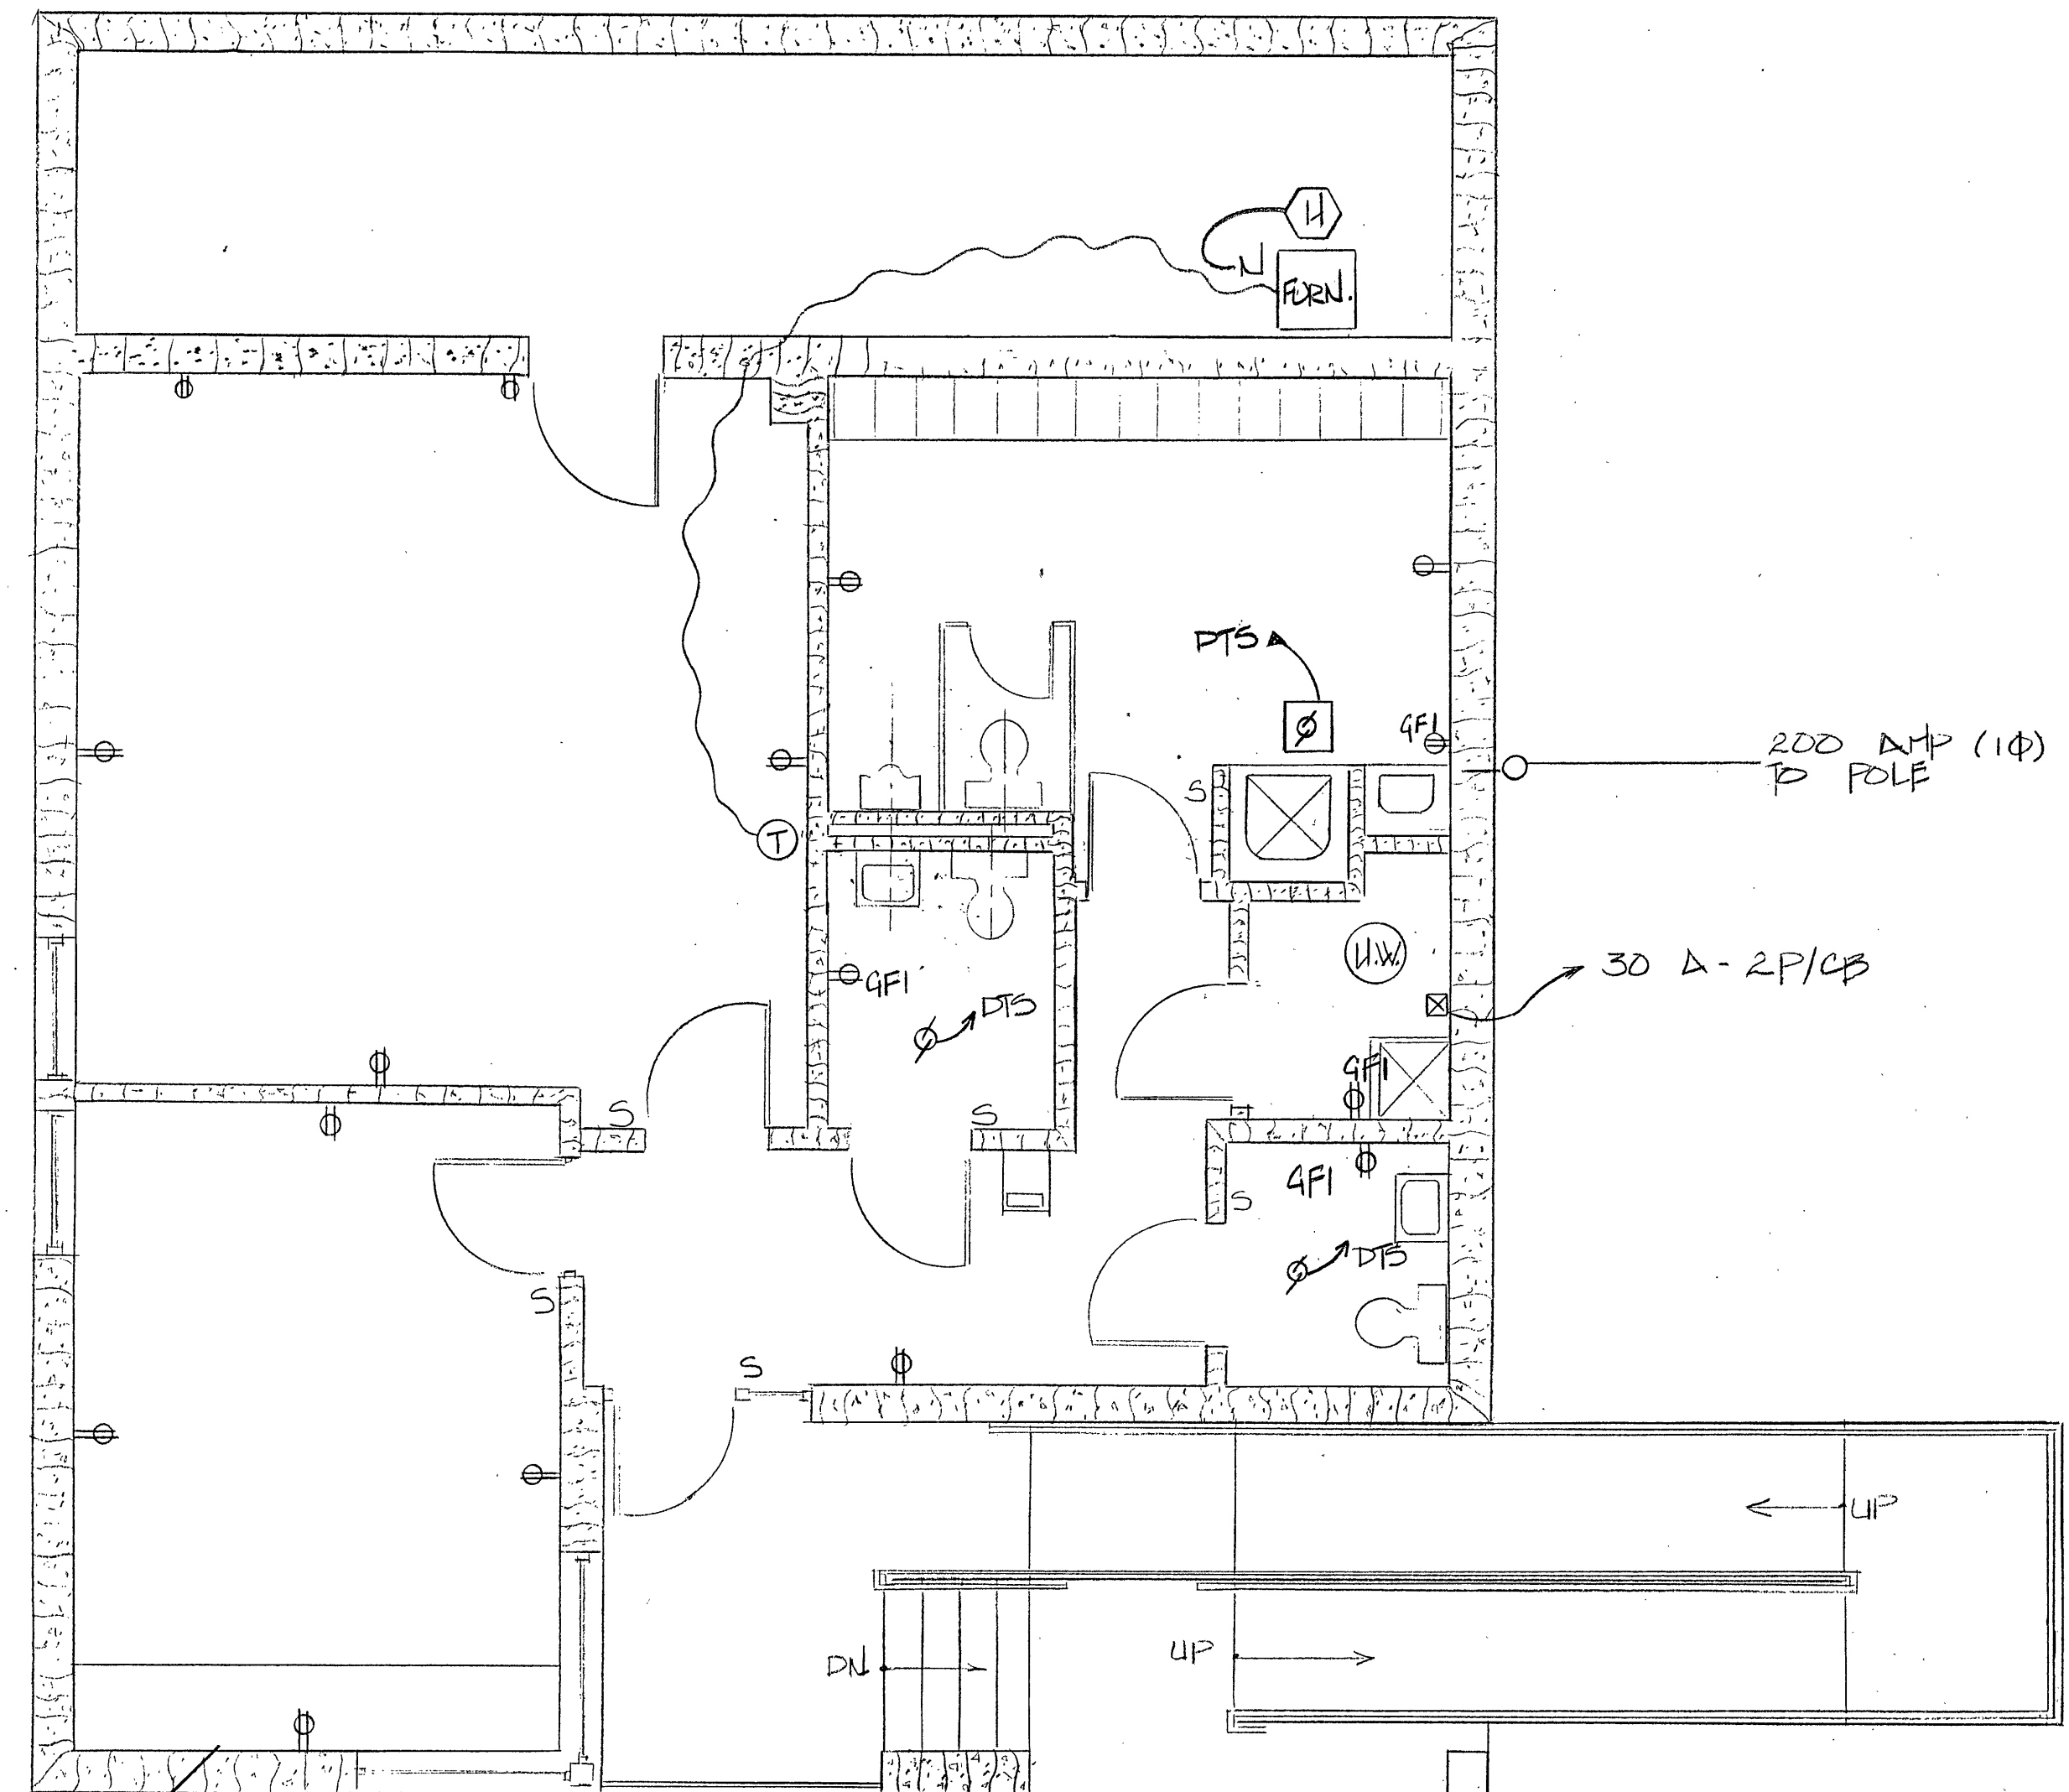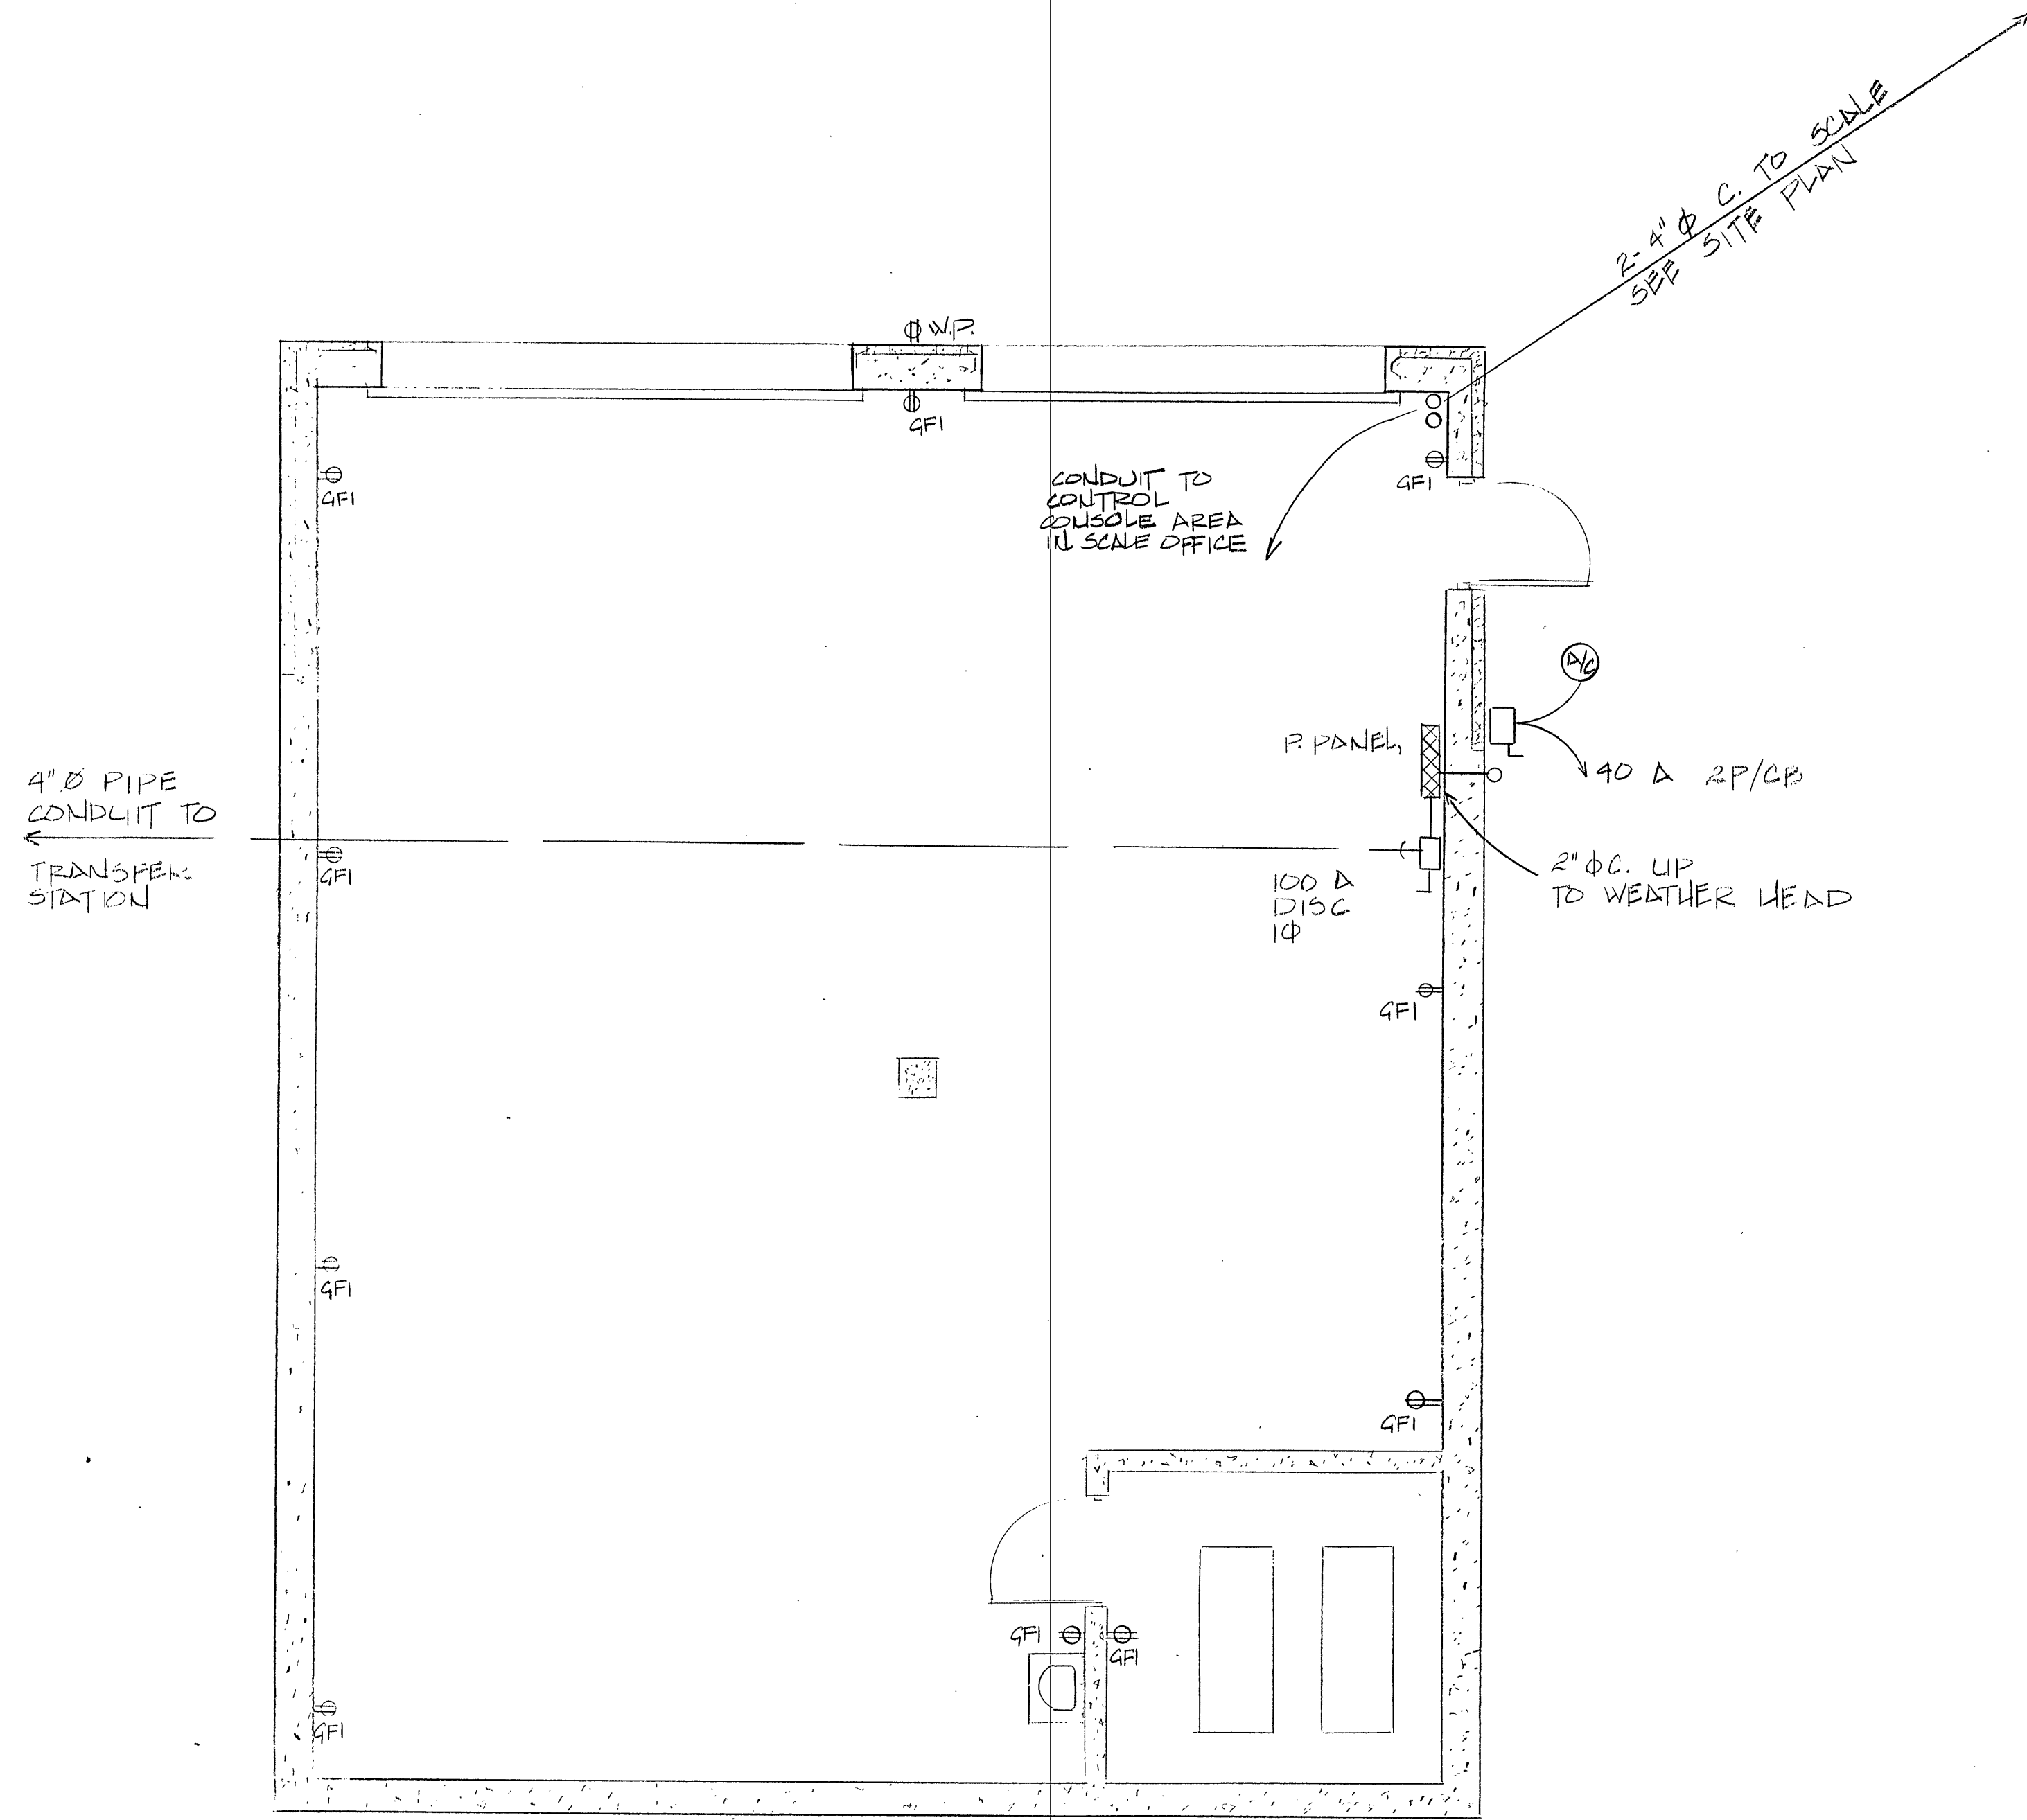

1 LOWER LEVEL POWER PLAN
SCALE: 1/4" = 1'-0"

2 UPPER LEVEL POWER PLAN
SCALE: 1/4" = 1'-0"

GENERAL NOTES:

1. THESE DRAWINGS ARE DIAGRAMMATIC ONLY. EXACT LOCATION OF ALL OUTLETS, SWITCHES, FIXTURES, ETC., MUST BE TAKEN FROM FINAL DETAILED ARCHITECTURAL DRAWINGS.
2. ALL JUNCTION BOXES INDICATED AND/OR REQUIRED SHALL BE SIZED TO ACCOMMODATE INCOMING AND OUTGOING FEEDERS.
3. HOMERUNS EXCEEDING 100' FROM SOURCE OF SUPPLY SHALL BE A MINIMUM OF #10 AWG-COPPER-3/4" C., UNLESS OTHERWISE INDICATED.
4. ALL WIRING FOR FIRE ALARM SYSTEM SHALL BE INSTALLED IN A 3/4" C., UNLESS OTHERWISE INDICATED.
5. THE ELECTRICAL CONTRACTOR MUST VERIFY CEILING FINISH CONSTRUCTION WITH FINAL ARCHITECTURAL DRAWINGS PRIOR TO ORDERING FIXTURES AND ORDER FIXTURES WITH PROPER MOUNTING ARRANGEMENTS TO BE COMPATIBLE WITH TYPE OF CEILING IN WHICH FIXTURE IS TO BE MOUNTED.
6. PROVIDE 2 - 1" C. EMPTY UP INTO ACCESSIBLE CEILING SPACE FROM EACH PANEL FOR FUTURE WIRING.

LEGEND

- ⊕ - UTILITY OUTLET @ 60" AFF-WP, G.E. OR EQUAL
- ⊙ - FAN/LIGHT MOTOR, BRAND #U95 WITH 4" DUCT TO BLDG. EXTERIOR.
- ⊠ - ELECTRICAL SUB-PANEL - G.E. OR EQUAL
- S - SWITCH - G.E. OR EQUAL
- 4FI - GROUND FAULT INTERRUPT, G.E. OR EQUAL
- ⊙ - THERMOSTAT, HONEYWELL OR EQUAL, ELECTRONIC NIGHT SET BACK, PROGRAMMABLE W/7 DAY CAPABILITIES.
- ⊠ - POWER PANEL, G.E. OR EQUAL
- DTS - DOWN TO SWITCH
- ⊕ WP - WEATHER PROOF OUTLET, G.E. OR EQUAL.